


Data Supplements

Figure S3

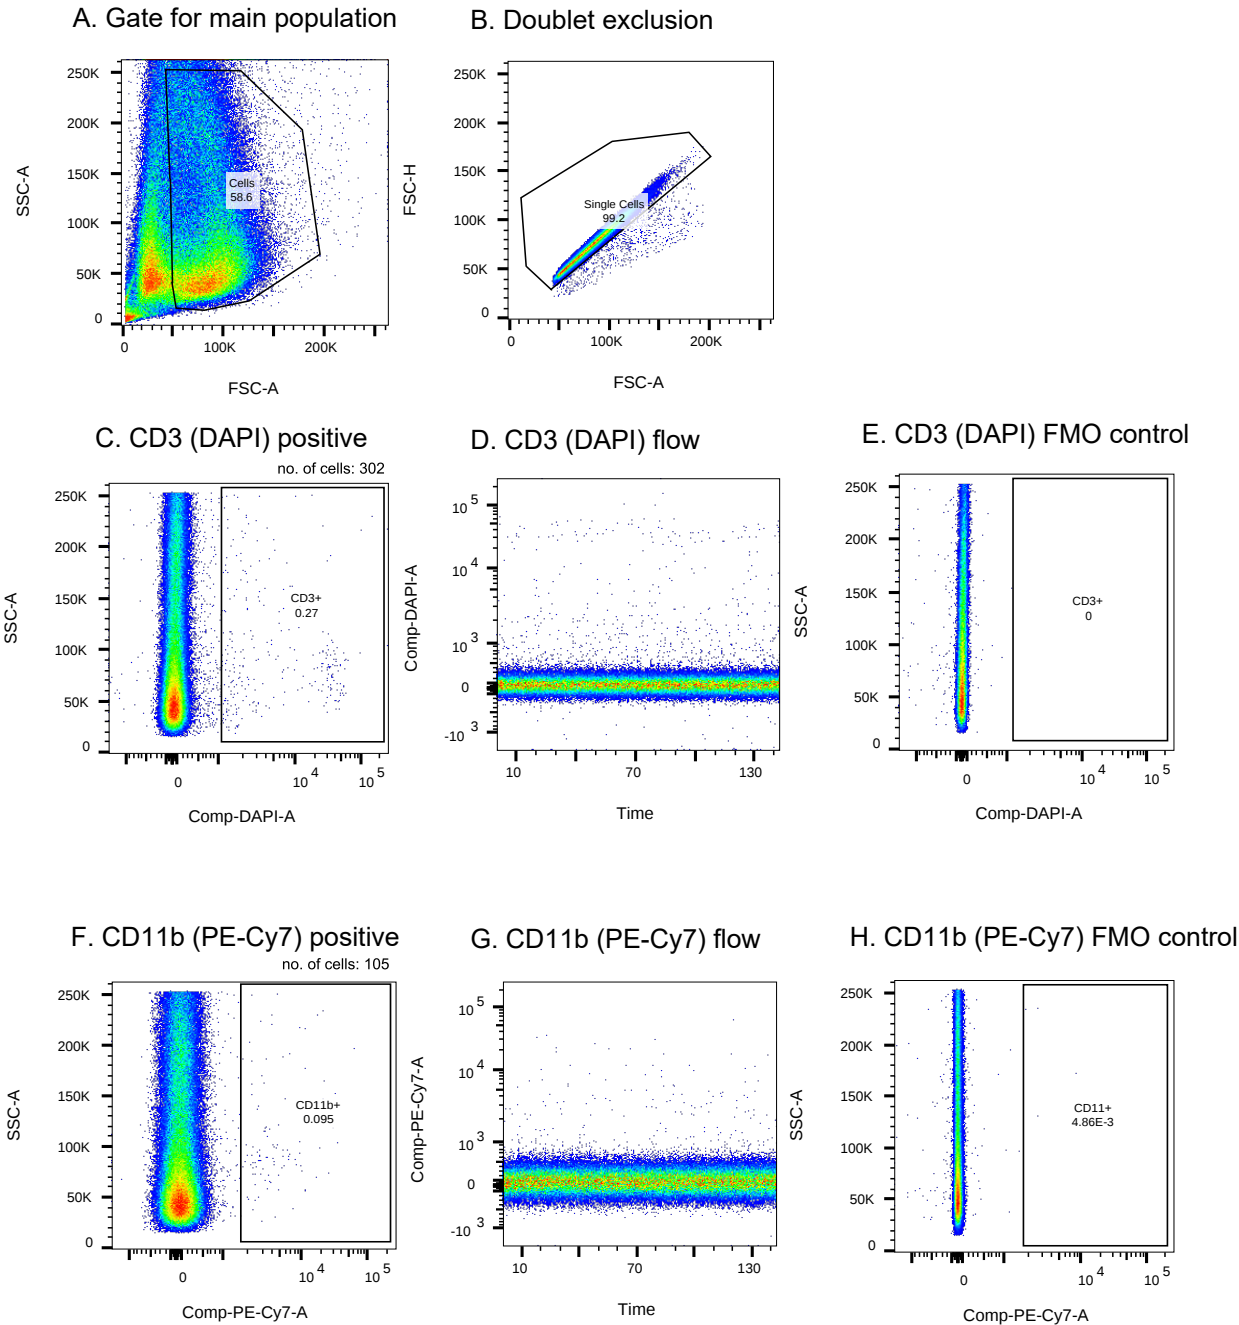

FMO: Fluorescence minus one control